




CLAVERACK RURAL ELECTRIC COOPERATIVE, INC.

32750 ROUTE 6
WYSOX, PENNSYLVANIA 18854
www.claverack.com --- 1-800-326-9799

UNDERGROUND TRENCH DETAILS (PAGE 1 OF 2)

PRIMARY TRENCH (SEE NOTE 9)

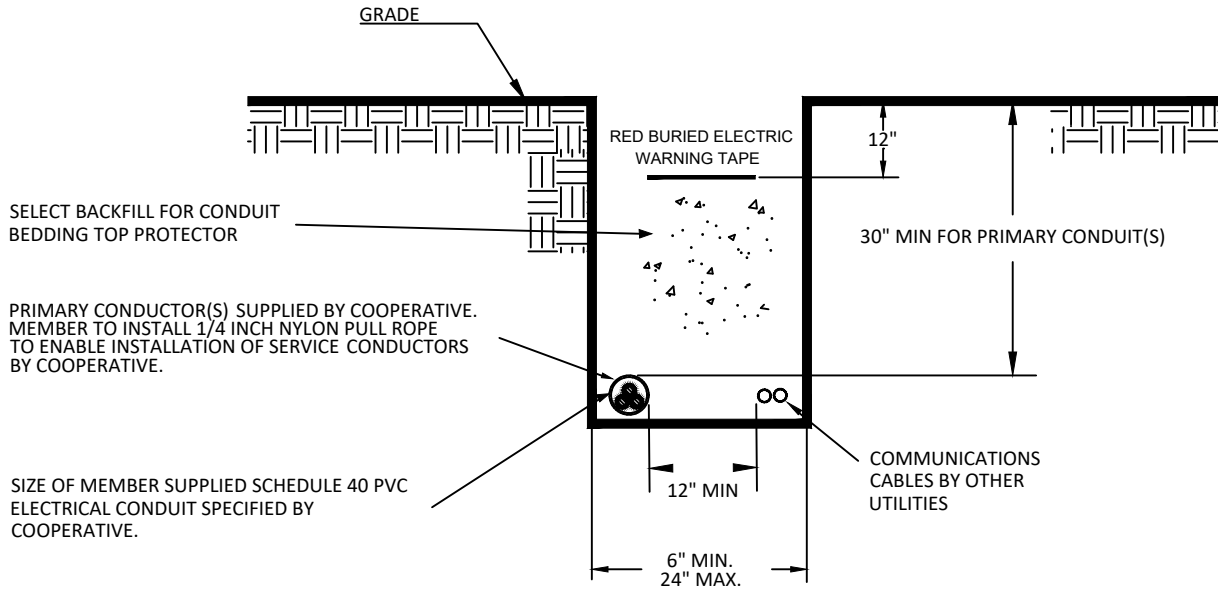


SELECT BACKFILL FOR CONDUIT BEDDING TOP PROTECTOR

PRIMARY CONDUCTOR(S) SUPPLIED BY COOPERATIVE. MEMBER TO INSTALL 1/4 INCH NYLON PULL ROPE TO ENABLE INSTALLATION OF SERVICE CONDUCTORS BY COOPERATIVE.

SIZE OF MEMBER SUPPLIED SCHEDULE 40 PVC ELECTRICAL CONDUIT SPECIFIED BY COOPERATIVE.

** PRIMARY TRENCHES MUST BE INSPECTED BY COOPERATIVE PRIOR TO BACKFILLING. SEE NOTE 9.

SECONDARY TRENCH

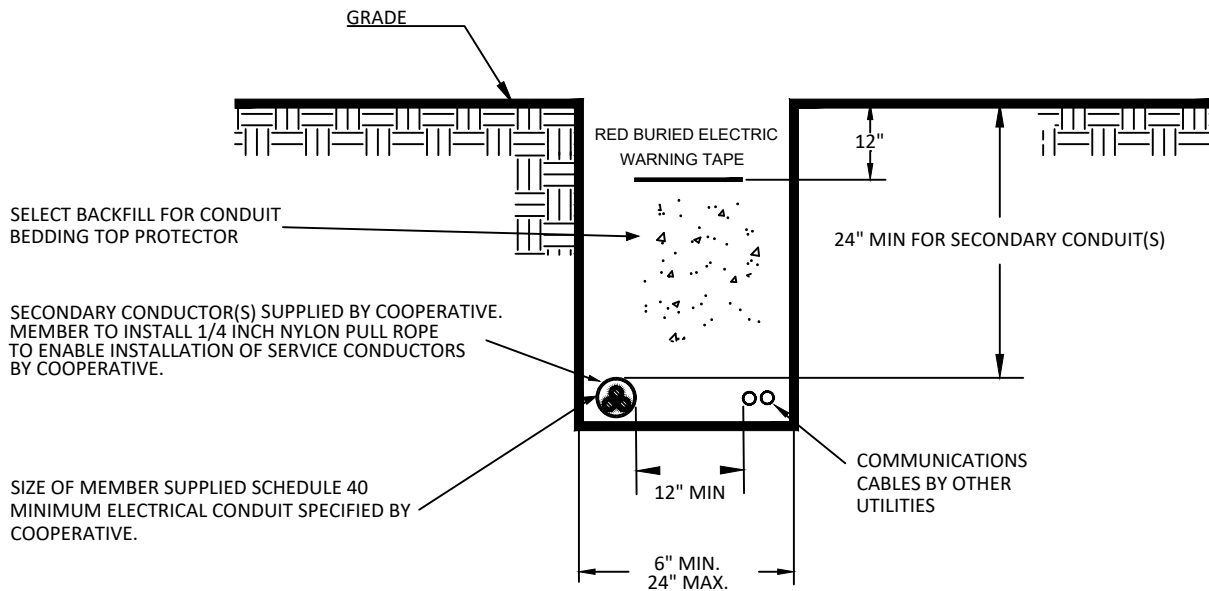

SELECT BACKFILL FOR CONDUIT BEDDING TOP PROTECTOR

SECONDARY CONDUCTOR(S) SUPPLIED BY COOPERATIVE. MEMBER TO INSTALL 1/4 INCH NYLON PULL ROPE TO ENABLE INSTALLATION OF SERVICE CONDUCTORS BY COOPERATIVE.

SIZE OF MEMBER SUPPLIED SCHEDULE 40 MINIMUM ELECTRICAL CONDUIT SPECIFIED BY COOPERATIVE.

COMMUNICATIONS CABLES BY OTHER UTILITIES